




COMMERCIAL GRADE SOLAR WATER HEATING TECHNOLOGY

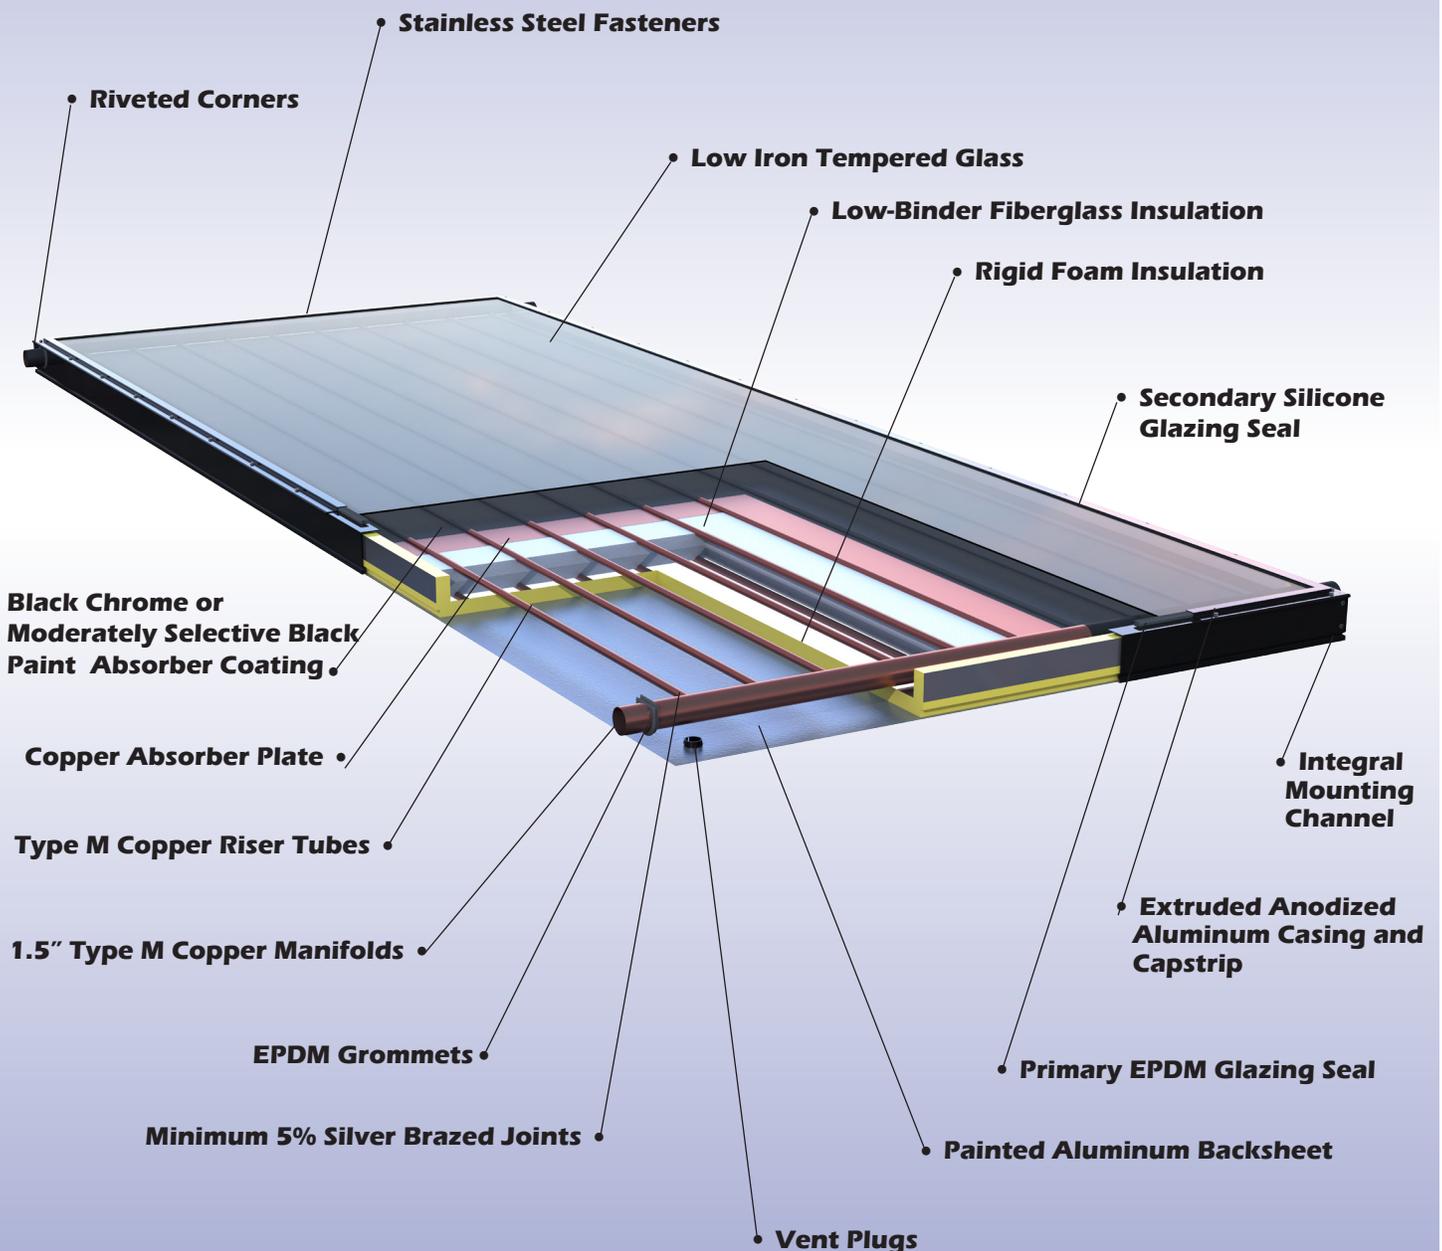

SUN EARTH INC. EMPIRE COMMERCIAL SERIES SPECIFICATIONS

SunEarth Model No.	Width Inches	Length Inches	Depth Inches	Gross Area Sq Ft	Net Aperture Sq Ft	Dry Weight, Lbs.	Fluid Capacity U.S. Gallons	Water Design Flow Rate GPM	40% Propylene Glycol Design Flow Rate GPM	Pressure Drop at Design Flow Rate in P-SIG	Max Flow Rate GPM	Std. Header Width, Inches	Std. Header Diameter, Inches Nominal	Header, Center to Center, Inches
EC/EP-32-1.5	48.2	98.2	3.25	32.8	29.7	115	1.41	0.97	1.11	0.006	25	51.38	1.5	93.63
EC/EP-40-1.5	48.2	122.2	3.25	40.9	37.2	150	1.61	1.20	1.39	0.006	25	51.38	1.5	115.63

ASTM E330 Maximim Test Load ±90 psf - Apply the appropriate factors of safety according to the test standards and local building code requirements when designing a solar thermal system

MODEL EC	THERMAL PERFORMANCE RATINGS*			MODEL EP			
	BTU/ft ² -Day			BTU/ft ² -Day			
Category (Ti-Ta)	High Radiation 2000 BTU/ft ² -Day	Medium Radiation 1500 BTU/ft ² -Day	Low Radiation 1000 BTU/ft ² -Day	Category (Ti-Ta)	High Radiation 2000 BTU/ft ² -Day	Medium Radiation 1500 BTU/ft ² -Day	Low Radiation 1000 BTU/ft ² -Day
A(-9°F)	1,360	1020	690	A(-9°F)	1,290	965	645
B(9°F)	1,250	910	580	B(9°F)	1,210	890	570
C(36°F)	1,070	745	420	C(36°F)	1,035	720	410
D(90°F)	700	400	120	D(90°F)	600	315	70
E(144°F)	330	95	-	E(144°F)	150	-	-

Ti = inlet fluid temp; Ta = ambient air temp. Category A/B-Pool Heating; C-Water Heating (Warm Climate); D-Water/Space Heating (Cool Climate); E- Process Heat. Thermal performance is obtained by multiplying the collector output for the appropriate application and insolation level by the total gross collector area
*Collector ratings are derived from the Solar Rating & Certification Corp (SRCC) Document RM-1 and Standard OG-100, tested with water at design flowrate.

ENGINEERING SPECIFICATIONS

(Performance specifications subject to testing error of +/- 3%)

The following shall be the specifications for the solar collectors. Collectors shall be SunEarth Empire Commercial model _____, and shall be of the glazed liquid flat plate type. Collectors shall be tested in conformance with ASHRAE 93-2003 and Solar Rating and Certification Corporation (SRCC) 100-10, ISO 9806-1 & 9806-2 and have their thermal performance rated according to SRCC Document RM-1. The collectors shall be certified by SRCC and the Florida Solar Energy Center (FSEC), and listed by the International Association of Plumbing and Mechanical Officials (IAPMO).

GENERAL

The dimensions of the collector shall be _____ inches in length, _____ inches in width and 3.25 inches in depth. The collector casing shall be an anodized aluminum extrusion (alloy 6063 T6), minimum thickness 0.060 inch, with an architectural dark bronze finish. The casing shall have notched framewalls for ease of plate removal and reinstallation. Sheet metal screwed fasteners shall be stainless steel (18-8 #10). The backsheet shall be painted textured aluminum not less than 0.014 inch thickness. A 1 inch vent plug shall be installed in each of the four corners of the backsheet to minimize condensation. An integral mounting channel shall allow the solar collector to be mounted without penetration of the extruded aluminum casing.

GLAZING

The collector glazing shall be one sheet of low iron tempered glass, with a minimum of 0.125 inch thickness (0.15625 inch on EC/EP-40-1.5), and a minimum transmissivity of 91 percent (89 on EC/EP-40-1.5). The glazing shall be thermally isolated from the casing by a continuous EPDM gasket. There shall be a continuous secondary silicone seal between the glass and casing capstrip to minimize moisture from entering the casing.

INSULATION

The insulation shall be foil-faced polyisocyanurate foam sheathing board of a minimum 1 inch thickness, siliconed in place to the aluminum backsheet, covered

by low-binder fiberglass of a minimum 1 inch thickness, providing thermal isolation of the foam from the absorber plate. Total thermal resistance shall be a minimum of R-12. The sides and ends of the collector shall be insulated with a minimum of 1 inch foil-faced polyisocyanurate foam sheathing board.

ABSORBER PLATE AND PIPING

The absorber shall consist of a roll-formed copper plate of no less than 0.008 inch thickness. Risers shall be a minimum of 0.50 inch O.D. Type M copper tubing on no more than 4.56 inch centers continuously soldered to the plate utilizing a non-corrosive solder paste with a melting point of 460°F. The risers shall be brazed to 1.625" O.D. type M copper manifolds utilizing a copper phosphorous brazing alloy with no less than a minimum 5 percent silver content, and conforming to the American Welding Society's BCuP-3 classification. EPDM grommets shall isolate the manifold from the aluminum casing. The absorber plate shall be designed for 160 psig maximum operating pressure and 400F maximum operating temperature.

ABSORBER COATING AND PERFORMANCE CURVE

A) Black Chrome (EC Series): The absorber coating shall be black chrome on nickel with a minimum absorptivity of 95 percent and a maximum emissivity of 12 percent. The instantaneous efficiency of the collector shall be a minimum Y-intercept of 0.752 and a slope of no less than -0.724 BTU/ft²-hr.°F.

B) Moderately Selective Black Paint (EP Series): The absorber coating shall be a moderately-selective black paint with a minimum absorptivity of 94 percent and a maximum emissivity of 56 percent. The instantaneous efficiency of the collector shall have a minimum Y-intercept of 0.744 and a slope of no less than -0.910 BTU/ft²-hr.°F.

Note Please refer to the SRCC website at www.solar-rating.org for the actual y-intercept and slope for each collector.

Due to SunEarth's policy of continuous product improvement, specifications are subject to change without notice.

<p>MANUFACTURED BY:</p>  <p>SUN EARTH INC. 8425 Almeria Ave. • Fontana, CA 92335 (909) 434-3100 • Fax (909) 434-3101 www.sunearthinc.com</p>	<p>AVAILABLE FROM:</p>
---	------------------------